


В

А

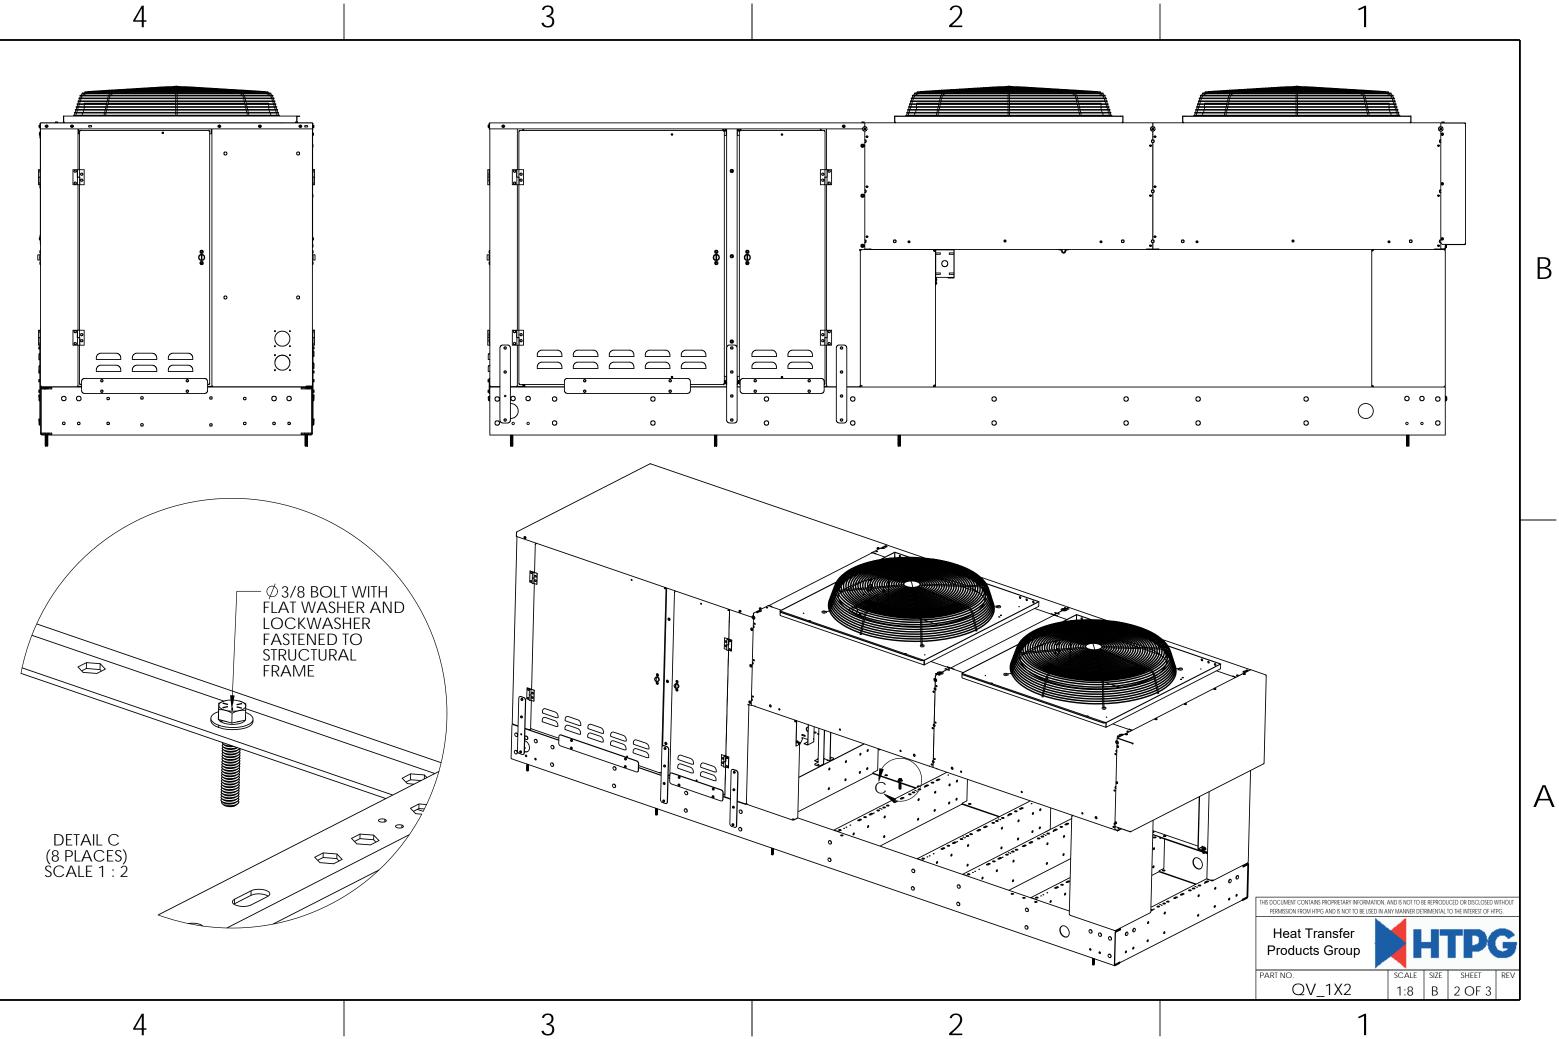

The units identified on these sheets have been analyzed and are compliant with the latest currently adopted state building codes (including but not limited to the 6th Edition Florida Building Code), International Building Codes and the American Society of Civil Engineers Minimum Design Loads for Buildings and Other Structures (ASCE/SEI 7-16). The analysis considered an Exposure Category C and a Building Risk Category II. The analysis determined the unit restraint and unit panel integrity of the Rheem units installed according to Rheem recommended approach conform to the high wind anchoring and integrity requirements for buildings up to 60 feet in height exposed to a 186 mile per hour 3-second wind gust.

3

3

2


2

NOTE: HTPG only assumes responsibility for the integrity of the equipment itself and the integrity of the anchoring of the equipment to the mounting surface.

А

4

4



В

А